



Seward Water/Wastewater Department – June 2010

| <i>PARAMETER MEASURED</i> | <i>SDW Standards</i> | <i>RO units</i> | <i>Well Water</i> | <i>POE</i> | <i>System</i> |
|--|----------------------|--------------------------|-----------------------|-----------------|---------------|
| pH (Standard Units) | 7.3-8.5 | 5.5 | 6.6 | 7.45 to 7.62 | |
| Nitrate (mg/L) | 10 | 3 | ~13 | 6.7 to 9.1 | |
| Average Total Chlorine (mg/L) | 0.1 - 4.0 | NA | NA | ~.2 | .2 - .25 |
| Hardness (Grains per Gallon) | NS | 0 | 24 | 8 – 12 | 8 – 12 |
| Water Temperature (Fahrenheit) | NS | NA | 49 - 55 F | ~52° F | 50°~60° |
| <i>WELL WATER PRODUCTION (Gallons)</i> | <i>WELL HIGH DAY</i> | <i>WELL YEAR TO DATE</i> | <i>WELL LAST YEAR</i> | <i>RECOVERY</i> | <i>BLEND</i> |
| 23,256,832 | 1,106,260 | 270,528,000 | 279,296,000 | 80% | 50% |

Water Pumped

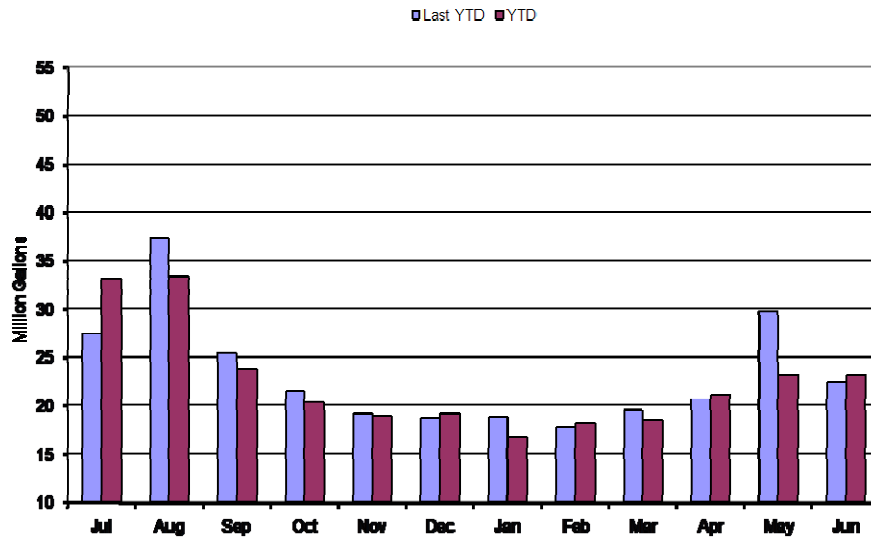

Precipitation

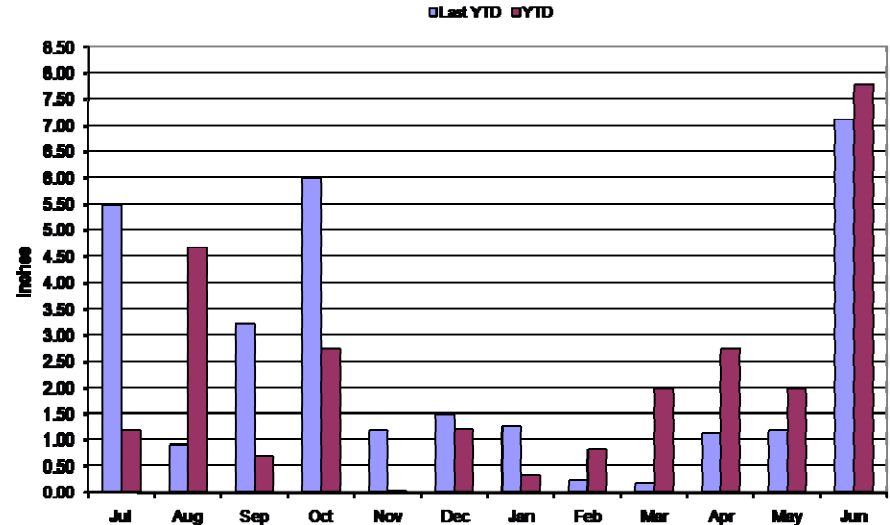

| <i>WASTEWATER TREATED (Gallons)</i> | <i>High Day</i> | <i>Average</i> | <i>Minimum</i> | <i>Sludge Loads Hauled</i> |
|-------------------------------------|-----------------|----------------|----------------|----------------------------|
| 25,392,800 | 16,187,000 | 846,400 | 572,500 | 6 |

POE = Point of entry into system